


**For standard tanks from WAB.1800 - WAB.4400.
For specialist needs please contact the sales team.**

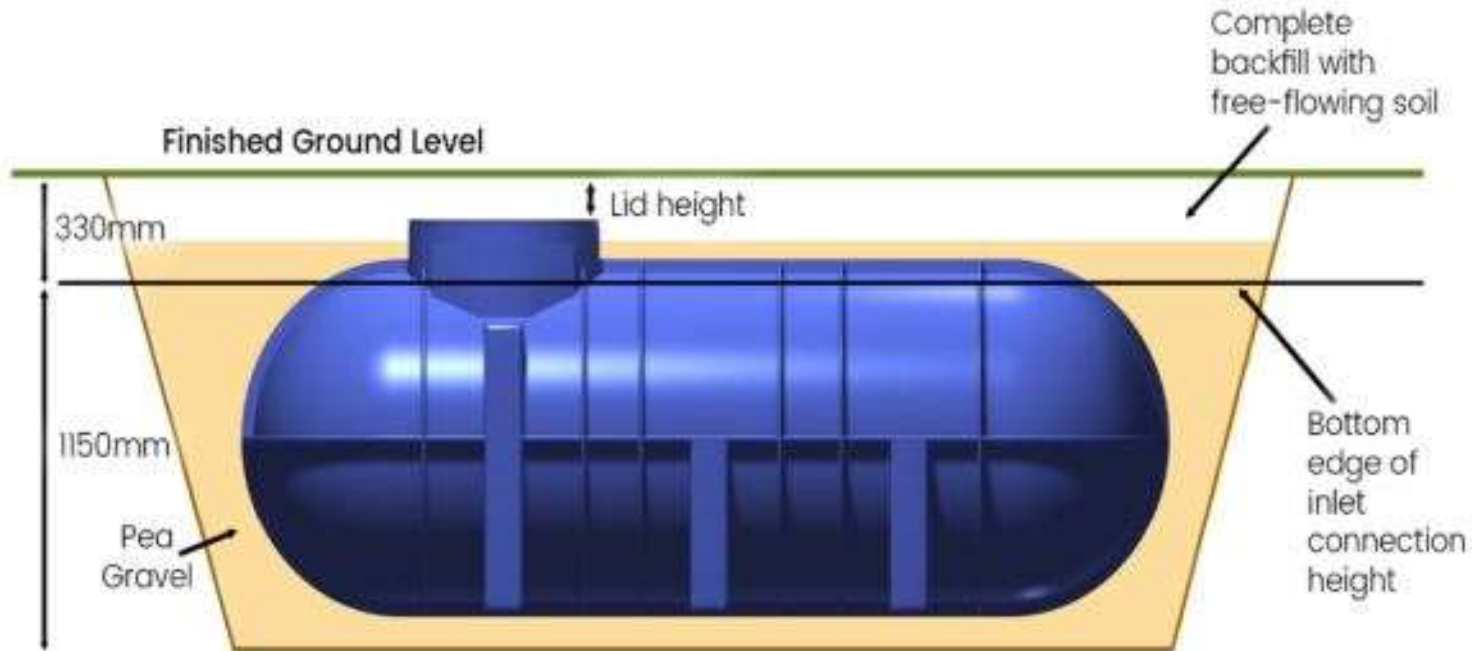

Bed on 50mm of rounded pea-gravel & backfill to 50mm above tank top with same material

Note: See page 5 for the orientation of the ducts on your tank.

Note: Remember the service duct needs to align with the controls inside the building as the supply pipe has limited flexibility.

Note: There is an invert drop of 66mm across the PF filter, and 300mm across the VF-1 filter.

Note: Ground cover depth will vary if telescopic neck is used.